

## NOTICE OF SERVICE INTERRUPTION/WORK FORM

<b>Date of Request (yyyy/mm/dd):</b> _____		<b>Requester:</b> _____							
<b>Start Date – End</b>									
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>Start Date (yyyy/mm/dd) _____</td> <td>Time (s) _____</td> </tr> <tr> <td>End Date (yyyy/mm/dd) _____</td> <td>Time (s) _____</td> </tr> </table>		Start Date (yyyy/mm/dd) _____	Time (s) _____	End Date (yyyy/mm/dd) _____	Time (s) _____	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>Notes _____</td> </tr> <tr> <td>_____</td> </tr> </table>		Notes _____	_____
Start Date (yyyy/mm/dd) _____	Time (s) _____								
End Date (yyyy/mm/dd) _____	Time (s) _____								
Notes _____									
_____									
<b>Building(s) Affected:</b>	1: _____	2: _____							
	3: _____	4: _____							
<b>Areas/Rooms Affected:</b> _____									
<b>Service to be interrupted:</b>	1: _____	2: _____							
	3: _____	4: _____							
<b>Description/Reason for Project:</b>									

<b>Contractor:</b> _____	<b>Phone #:</b> _____
<b>Contractor/Project Managers:</b> _____	<b>Phone #:</b> _____

Should you have any questions or concerns, please contact


**Notes:**

- Day 1 Oct 2
- Day 2 Oct 3
- Day 3 Oct 4
- Day 4 Oct 5
- Day 5 Oct 6

**NOTES:**

1. NEW FIXTURE WITH NEW 16FT ROUND POLE. MODIFY BASE TO SUIT EXIST CONCRETE BASE.
2. NEW FIXTURE WITH NEW 20FT ROUND POLE. MODIFY BASE TO SUIT EXIST CONCRETE BASE.

*Sea Can Drop off.*

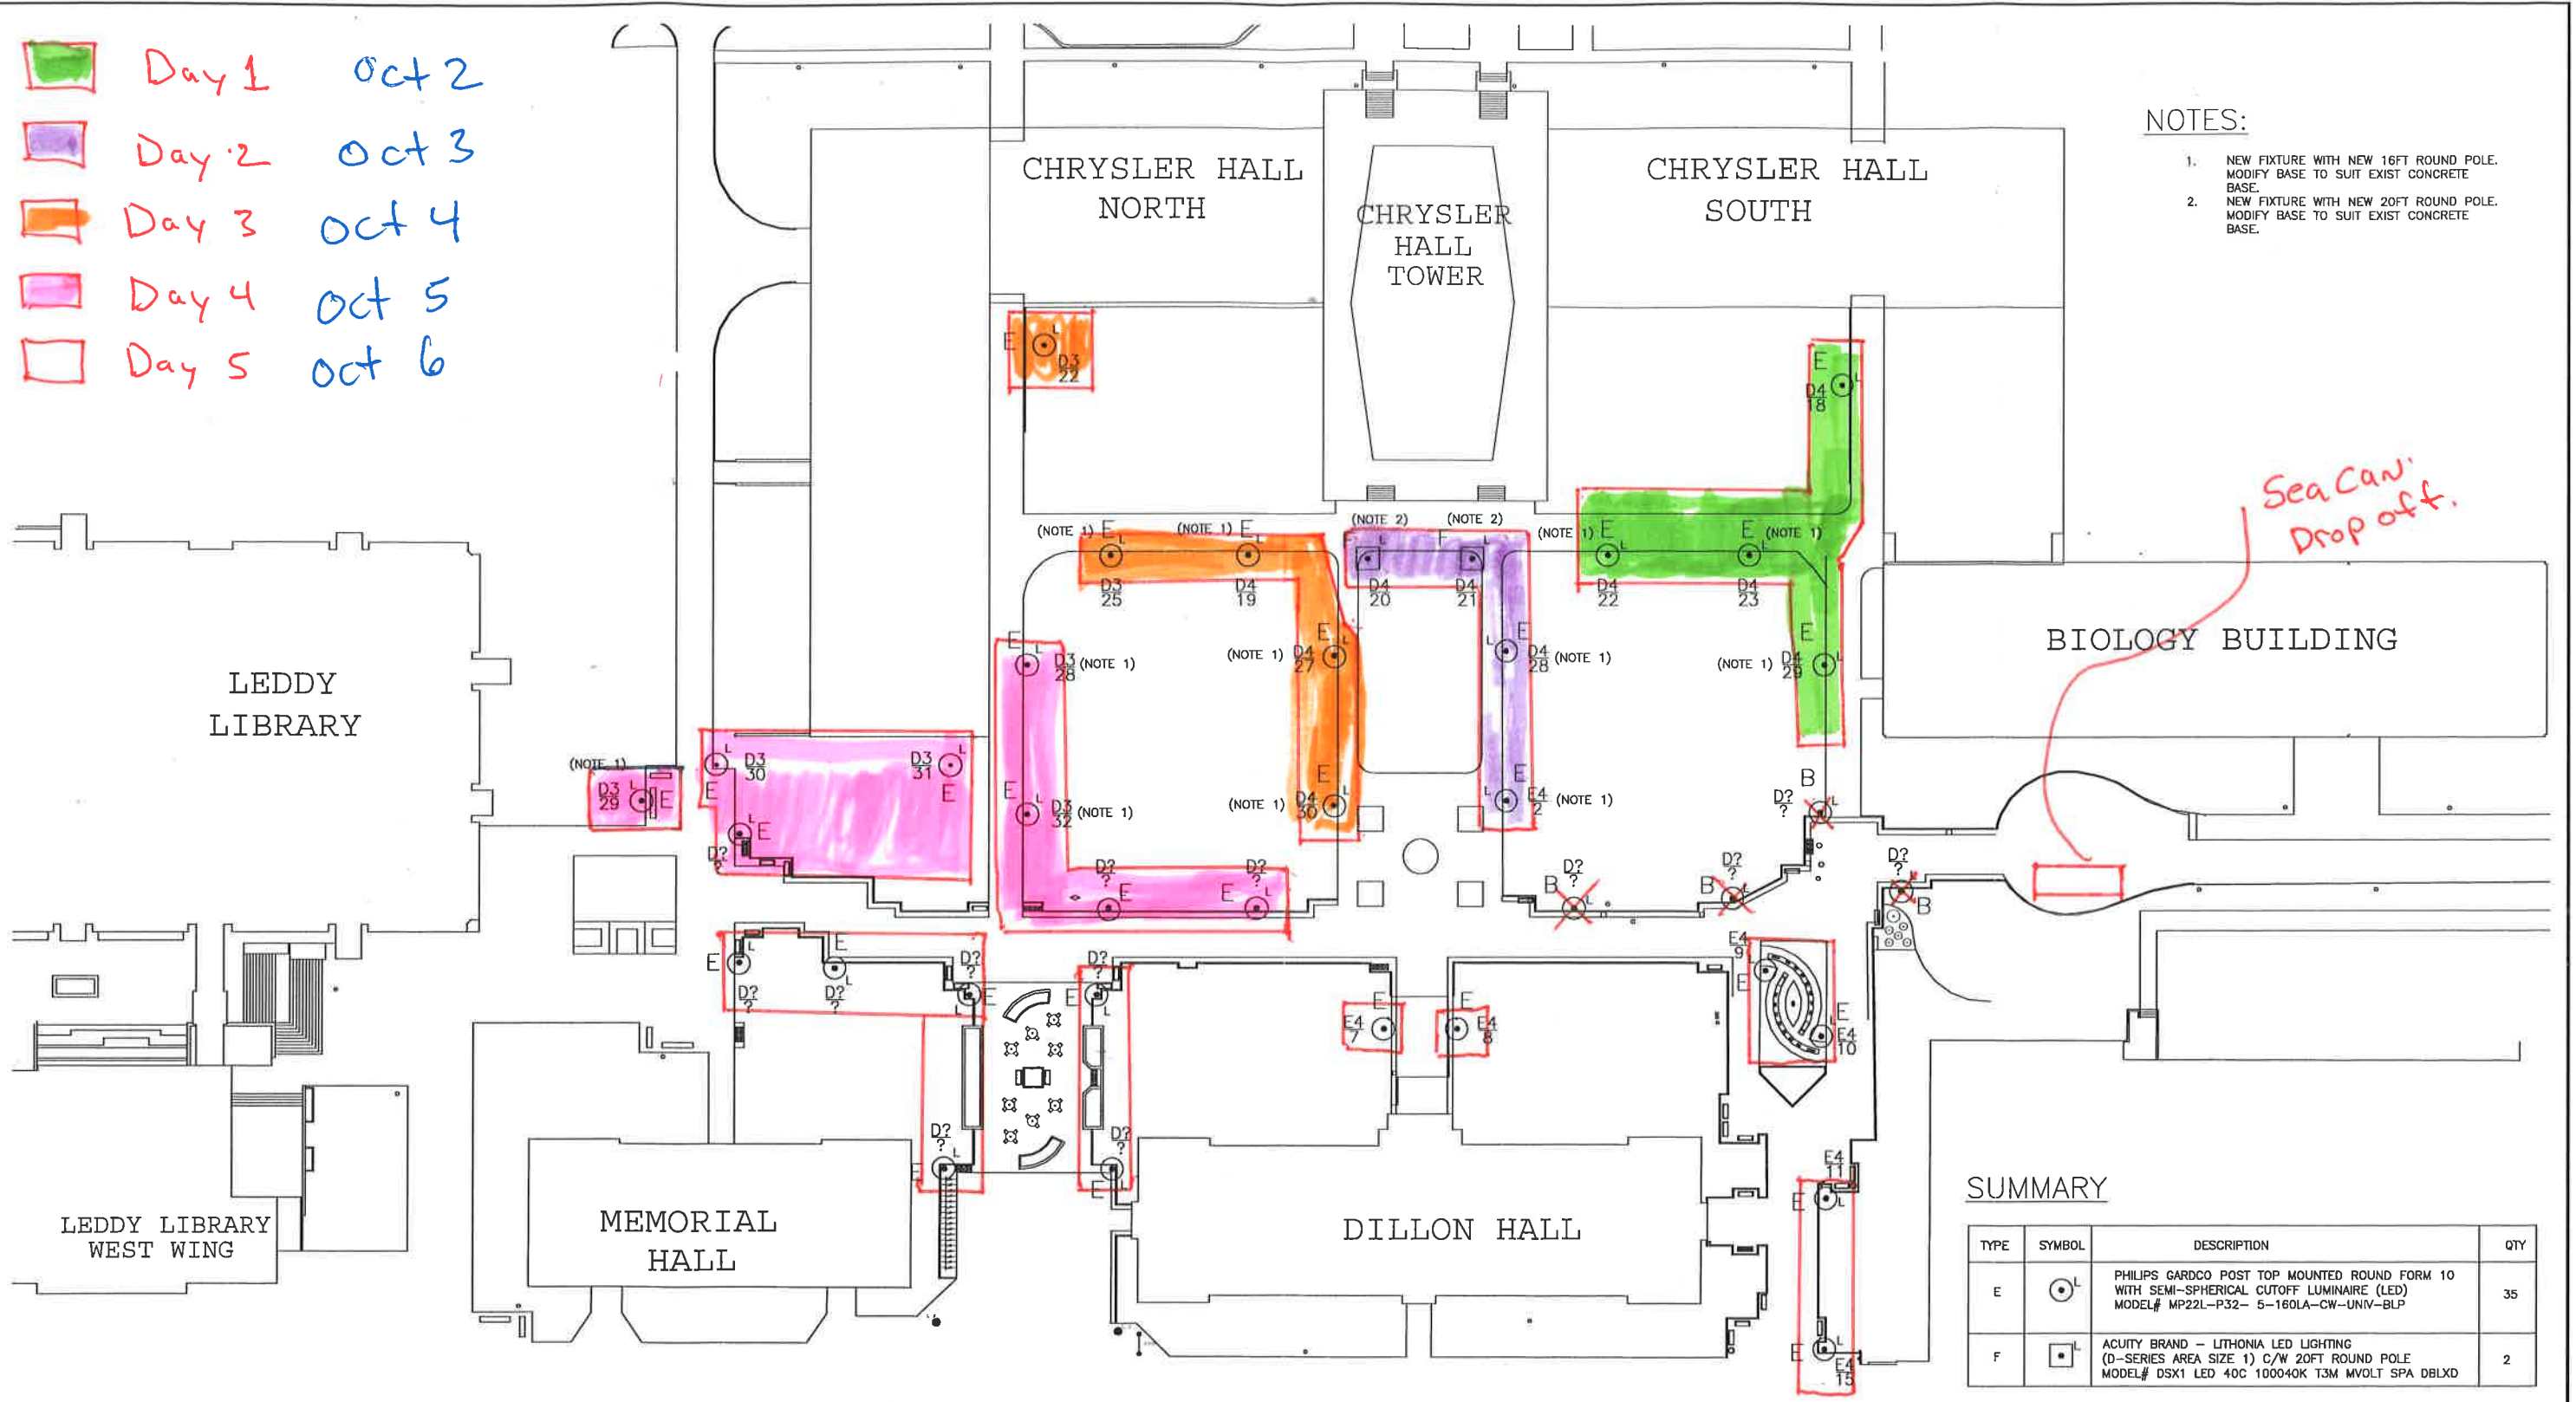

**SUMMARY**

TYPE	SYMBOL	DESCRIPTION	QTY
E	⊙	PHILIPS GARDCO POST TOP MOUNTED ROUND FORM 10 WITH SEMI-SPHERICAL CUTOFF LUMINAIRE (LED) MODEL# MP22L-P32- 5-160LA-CW-UNV-BLP	35
F	⊠	ACUITY BRAND - LITHONIA LED LIGHTING (D-SERIES AREA SIZE 1) C/W 20FT ROUND POLE MODEL# DSX1 LED 40C 100040K T3M MVOLT SPA DBLXD	2

**Conditions of Use**  
 Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.  
 Do not scale dimensions from drawing.  
 Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.



NO.	ISSUED FOR	DATE	BY
2	CONSTRUCTION	05/05/2017	BLD
1	ADDENDUM No 1	01/09/2017	BLD
0	CLIENT REVIEW	DEC 2016	BLD

DESIGN	BLD	REVIEWED BY	BLD	UNIVERSITY OF WINDSOR CAMPUS WALKWAY LIGHTING	PROJECT NO 16-4560
DRAWN	PRP	CHECKED BY	BLD		
DATE	DEC 2016			ELECTRICAL	SHEET NO
SCALE	1/32"=1'-0"			INSTALLTION	<b>E-200</b>